POWERLOK PDU SPECIFICATION

Specific Configurations

| COLOR | CARBON | | RED | | WHITE | | BLUE | |
|----------------|--|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| WHIP LENGTH | 6 FT | 10 FT | 6 FT | 10 FT | 6 FT | 10 FT | 6 FT | 10 FT |
| BASIC PART NO. | UP8811B-06C | UP8811B-10C | UP8811B-06R | UP8811B-10R | UP8811B-06W | UP8811B-10W | UP8811B-06B | UP8811B-10B |
| DESCRIPTION | RACK PDU, 82", 60A 240/415V WYE 3PH, 54-C13, IEC 309 (IP44), CORDLOK | | | | | | | |
| POWER | 60A 240/415V WYE 3PH (34.4 kW) | | | | | | | |
| PLUG TYPE | IEC 309 (IP44) SPLASHPROOF | | | | | | | |
| UNIT LENGTH | 82 INCHES | | | | | | | |
| RECEPTACLES | 54-C13 | | | | | | | |
| CORDLOK | YES | | | | | | | |

Universal Specification

| Over Current Protection | 20A UL489 magnetic breakers | | | |
|---------------------------------------|--|--|--|--|
| Power Whip | See PDU Ratings Table - page 2 | | | |
| Heavy Steel - Powder Coat Color | Per PowerLok specific configuration for color | | | |
| Rack PDU Type | Vertical Rack-mount | | | |
| Toolless Mounting: Center Spacing | 61.25" | | | |
| Manufactured in the USA | Yes | | | |
| Product Warranty | 3-year from date of shipment, repair or replace. | | | |
| Certification/Agency Approvals | TUV Certified to UL/CSA 60950-1 with NOM Addendum for Mexico, FCC Part 15 Class A conformance, RoHS compliant | | | |
| Operating Environment | 0-60C (32-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation. | | | |
| Storage Environment | -25-65C (-13-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation. | | | |
| Chassis Dimensions (LxWxD) | 82.0"L x 2.18"W x 2.0"D | | | |
| Package Dimensions (LxWxD) | 90.0"L x 22.0"W x 4.8"D (3&4-Pack), 80.0"L x 11.0"W x 4.8"D (1&2-Pack) | | | |
| Pallet Dimensions (LxWxD) | 92"L x 44"W x 5.0"D | | | |
| Rack PDU Weight | 21.3 lbs. | | | |
| Packaged Weight (each) | 23.3 lbs. | | | |
| Monitored & Switched Versions Only | | | | |
| MONITORING TYPE: | REMOTE & TOUCHSCREEN DISPLAY, ENVIROLOK READY. SWITCHED READY | | | |
| Monitoring Accuracy | Voltage: +/- 0.5% at nominal. Current: within 0.5% from 1A to 30A typical. +/1% of measurement from 500mA to 30A. | | | |
| Total Unit & Group Monitoring | Aggregate (kWh, W, VA) plus Phase: A, B, C Line Currents, plus Group: 1, 2, 3 Monitoring (kWh, W, VA, PF, V, A) | | | |
| Network Interface | Ethernet RJ-45, 10 Mbit/s, 100 Mbit/s | | | |
| Transport/Internet | TCP/IP v4, v6 | | | |
| Network Applications | HTTP/HTTPS Webserver SNMP-V1/V2c/V3 Network Management DHCP for dynamic IP address request from a server on the network. Remote firmware upgrade using FTP. | | | |
| Touch & Rotatable Digital Display | Touch to rotate / touch to view data screens | | | |
| Internal RMS Voltage Sensor | Yes | | | |
| Internal RMS Current Sensor | Yes | | | |
| | Optional EnviroLok daisy chain temp/humidity (optional - up to 4 sensors). | | | |


| MADE AND ROBOTICALLY SOLDERED IN THE | |
|--------------------------------------|--|
| | |

POWERLOK

| JSA | | | | | |
|--|-------|---|----------------------------------|------------------|--|
| *CUSTOMER SIGNATURE: | DATE: | UNLESS OTHERWISE SPECIFIED, ALL | Upsite Technologies | | |
| *PRIOR TO MANUFACTURING, BUILD MODELS REQUIRE CUSTOMER SIGN-OFF. BY SIGNING, CUSTOMER AGREES THAT THIS ORDER IS NON- CANCELABLE AND NON-RETURNABLE. | | DIMENSIONS ARE IN MM AND TOLERANCES ARE: X = +/- 0.5 .X = +/- 0.25 .X = +/- 0.13 X* = +/- 0.5* | TITLE: RACK PDU SPECIFICATION | | |
| | | | DRAWING NUMBER: SP-UP8811 | SHEET: 1 OF 2 | |
| | | | | 0.5 | |

Example drawing shown. See table for actual receptacle configuration.

THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF Upsite Technologies AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY Upsite Technologies. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE.

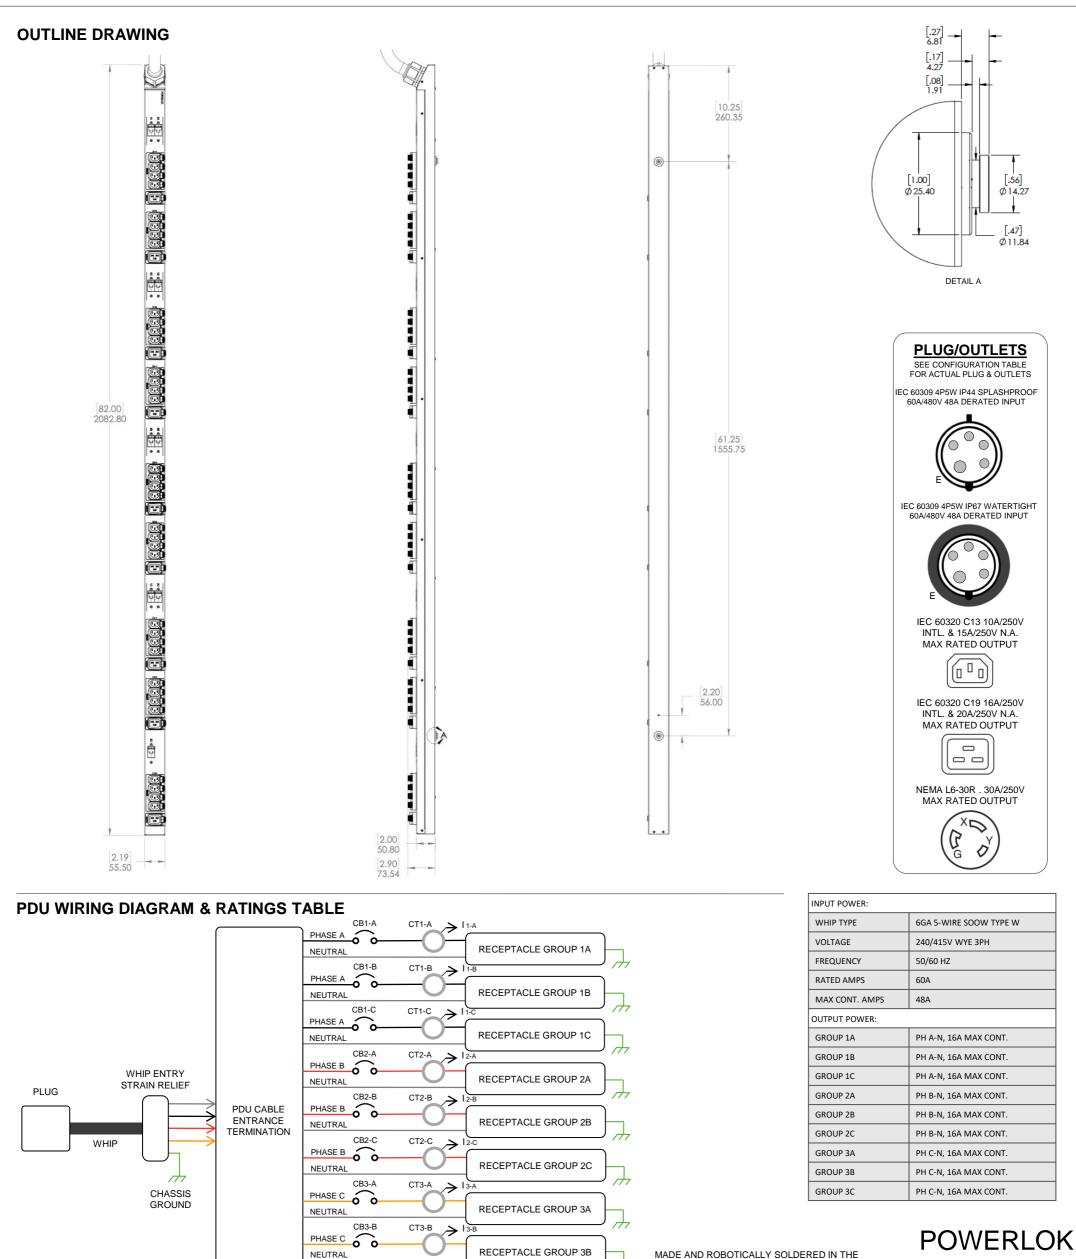

NEUTRAL

NEUTRAL

PHASE C

CB3-C

CT3-C

 \geq

RECEPTACLE GROUP 3C

MADE AND ROBOTICALLY SOLDERED IN THE

Æ

 $\overline{}$

| CUSTOMER APPROVAL* | DATE | | Upsite Technologies | | | |
|---|-----------------------------------|--|----------------------------------|--|--|--|
| *CUSTOMER SIGN-OF | URING. | UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS IN MM AND TOLERANCES ARE X: +/5 .X: +/25 | TITLE: RACK PDU SPECIFICATION | | | |
| *BY SIGNING THIS APP CUSTOMER AGREES TH CAN NOT BE CANCELE CUSTOM PRODUCTS C | HAT THIS ORDER D AND <u>NO</u> | .X: +/13 X°: +/5° | 13 | | | |
| THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GATEVIEW TECHNOLOGIES, INC. AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GATEVIEW TECHNOLOGIES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE. | | | | | | |